

Cable Substitution Chart

Per 2005 NEC®

FIRE-RESISTANCE LEVEL

Test Requirements

NEC ARTICLES

800

725

760

820

770

830

PLENUM

4 (Highest)

NFPA 262
(UL-910
Steiner Tunnel)

RISER

3

UL-1666
(Vertical Shaft)

GENERAL PURPOSE


2

UL-1685
Vertical Tray
or CSA FT4
(UL 1581)

RESIDENTIAL

1 (Lowest)

VW-1
(Vertical Flame)

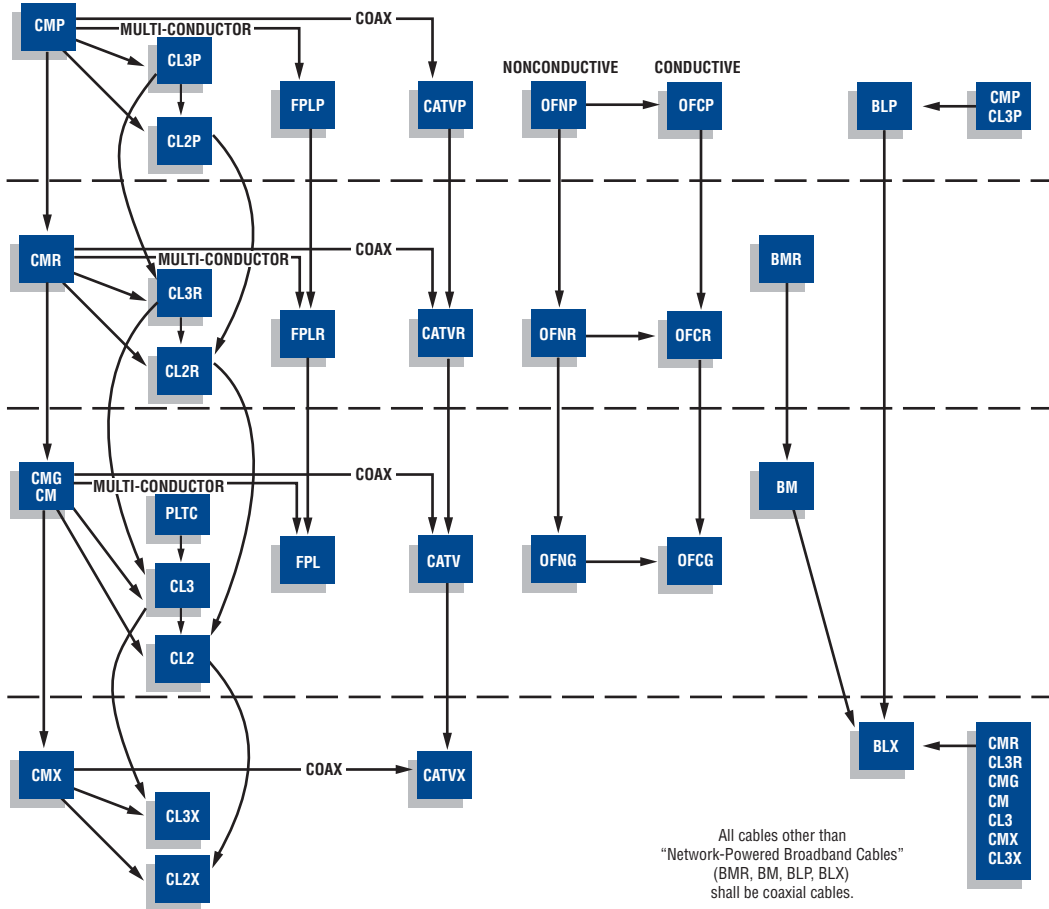

→ Cables indicated can be substituted.